

# ELR-3C

## EARTH LEAKAGE RELAY - MODULAR VERSION 3 MODULES




### GENERAL CHARACTERISTICS

- Earth leakage relay type A
- External toroidal
- Green power LED indicator (ON)
- Red relay tripped LED indicator (TRIP)
- Front TEST and RESET buttons
- Configurable automatic or manual resetting
- Modular DIN housing, 3 module, with transparent cover
- Degree of protection: IP20 terminals, IP40 on front with cover

ORDER CODE	RATED AUXILIARY SUPPLY VOLTAGE	OUTPUTS CONTACTS	WT [kg]
ELR-3C 12	12 VAC/DC	1	0,190
ELR-3C 48	24-48 VAC/DC	1	0,190
ELR-3C 415	110 VAC/DC-240-415 VAC	1	0,190
OPTIONS			
T	Tropicalisation		

ADJUSTMENTS	
Configurable tripping set-point ( $I\Delta n$ )	0,025...0,25A
	0,25...2,5A
	2,5...25A 25...250A (with external multiplier CT1-M)
Configurable tripping delay time (t)	0,02...0,5s
	0,2...5s.

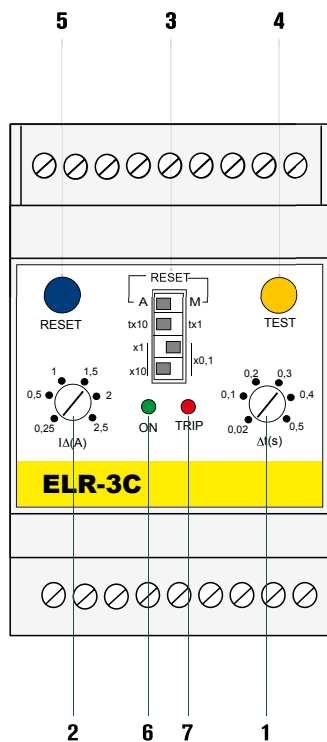


LEGENDA	
1	Tripping delay time adjustment
2	Fault current to earth adjustment
3	<p>Dip switches settings:</p> <p><b>3a</b> -auto reset (A) - man reset (M) auto reset = automatic reset man reset = manual reset through RESET key on the front. For remote resetting, simply shut off the auxiliary supply for about 1 second</p> <p><b>3b</b> -tx10 - tx1 constant selection for tripping delay time adjustment. Examples: positioning the dip switch on tx10 and the potentiometer on 0.3 we will have a tripping delay upon exceeding the <math>I\Delta n</math> threshold of <math>0.3 \times 10 = 3</math> seconds; positioning the dip switch on tx1 and the potentiometer on 0.3 we will have a tripping delay upon exceeding the <math>I\Delta n</math> threshold of <math>0.3 \times 1 = 0.3</math> seconds</p> <p><b>3c</b> -<math>I\Delta n \times 0,1</math> - <math>I\Delta n \times 1</math> - <math>I\Delta n \times 10</math> constant selection for fault current to earth adjustment. The constants in relation to the position of the 2 dip switches are the following:</p> <ul style="list-style-type: none"> <li>• dip switch position <math>I\Delta n \times 0,1</math> and <math>I\Delta n \times 0,1</math> K = 0,1</li> <li>• dip switch position <math>I\Delta n \times 1</math> and <math>I\Delta n \times 0,1</math> K = 1</li> <li>• dip switch position <math>I\Delta n \times 1</math> and <math>I\Delta n \times 10</math> K = 10</li> </ul>
4	TEST key. Causes tripping of the relay.
5	RESET key. To reset the relay after tripping. For remote reset, simply shut off the auxiliary supply for about 1 second.
6	ON LED. Indicates the presence of auxiliary voltage.
7	TRIP LED. Lighting up indicates the cutting in of the TRIP relay due to exceeding the $I\Delta n$ set.

# ELR-3C

## EARTH LEAKAGE RELAY - MODULAR VERSION 3 MODULES

TECHNICAL CHARACTERISTICS	ELR-3C		
<b>CONTROL CIRCUIT</b>			
Toroidal transformer	External		
Adjustments tripping set-point (I $\Delta$ )	0.025÷25A (25÷250A with external multiplier)		
Adjustments tripping time (t)	0.02÷5s		
<b>AUXILIARY SUPPLY</b>			
Auxiliary voltage (Us)	12 VAC/DC	24-48 VAC/DC	110 VAC/DC-240-415 VAC
Rated frequency	50-60 Hz		
Maximum power consumption	3 VA		
<b>OUTPUT RELAYS</b>			
Contact arrangement	1 changeover (trip)		
Rated contact capacity Ith	5 A (240 VAC)		
<b>INDICATIONS</b>			
Auxiliary voltage available (ON)	Green LED		
Relay tripping (TRIP)	Red LED		
<b>INSULATION</b>			
Insulation test	2.5kV for 1 minute		
<b>AMBIENT OPERATING CONDITIONS</b>			
Operating temperature	-10÷60 °C		
Storage temperature	-20÷80 °C		
Relative humidity	≤90%		
<b>ENCLOSURE</b>			
Version	3 modules DIN		
Degree of protection	IP20 terminals   IP40 with protective cover		
<b>CERTIFICATIONS AND COMPLIANCE</b>			
Reference standards	IEC/EN 61010, IEC/EN 61000-6-2	IEC/EN 61000-6-3, IEC/TR 60755	CEI EN 60947-2 Annex M

### WIRING CONNECTION

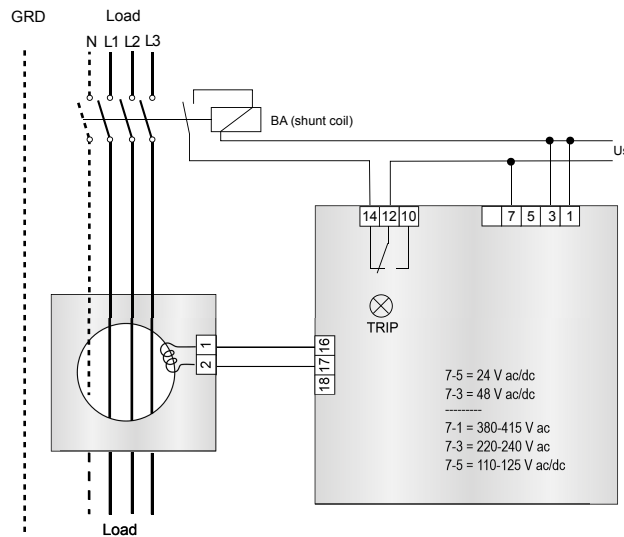

### MECHANICAL DIMENSIONS

